


DESIGNATION:
DESIGN 4021 Y


TOTAL LENGTH OF UNITS
STANDARD PLATE REFERENCE

EXAMPLE:
DESIGN 4021 8

TWO 4 FT. UNITS
CONSTRUCT PER
STANDARD PLATE 4021

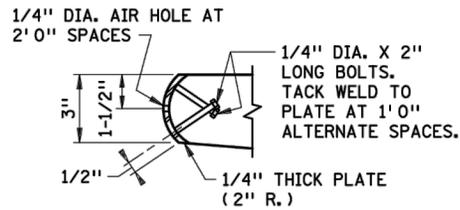


OPTION 1

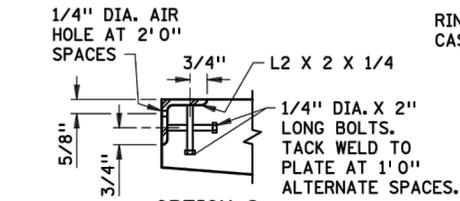


OPTION 2

STEEL NOSING

GALVANIZE AFTER FABRICATION PER SPEC. 3394




PLAN VIEW




SECTION

LUG
DETAIL

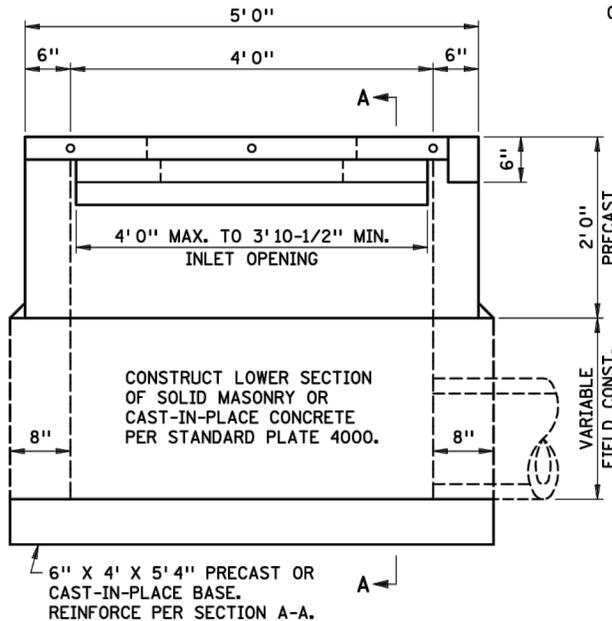

FRONT VIEW

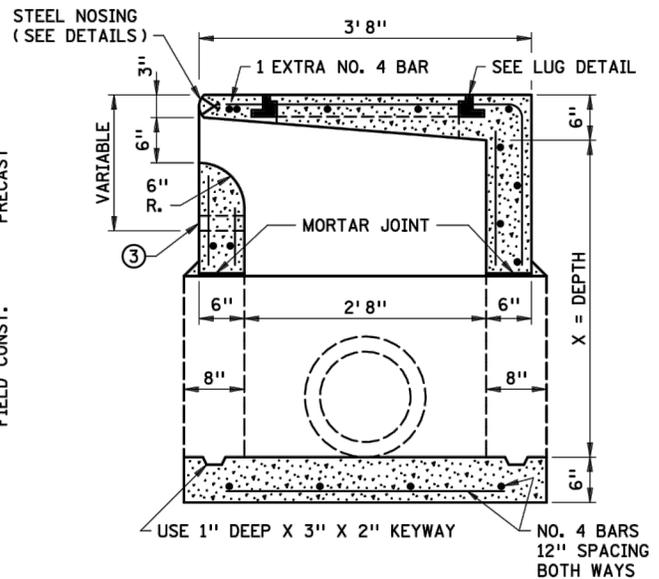

SECTION A-A

CONSTRUCTION NOTES:

- FOR INLETS LONGER THAN 4 FT., USE MULTIPLE UNITS. TOP AND SIDE JOINTS BETWEEN ADJACENT UNITS SHALL BE SEALED WITH OAKUM AND 1/2 IN. HOT POURED SEALER, SPEC. 3723.
- ONLY ONE MANHOLE REQUIRED PER INSTALLATION, LOCATED AT CENTER OF UNIT OVER OUTLET.
- PLACE PIPE OPENING AS REQUIRED.
- SLOPE FLOOR 5/8 IN. PER FT. TO OUTLET.
- WHEN MULTIPLE UNITS ARE INSTALLED, THE BASE AND LOWER WALL SHALL BE CONSTRUCTED AS ONE STRUCTURE.

- ① RING CASTING NO. 790-2, MODIFIED BY THE ADDITION OF LUGS AT QUARTER POINTS OR APPROVED EQUAL. SEE LUG DETAIL.
- ② COVER CASTING NO. 715 or 716 (SEE PLAN).
- ③ 3 IN. MAX. DIA. TEMPORARY INLETS ARE PERMITTED AT THE ELEVATION OF THE SUBGRADE TO PROVIDE DRAINAGE PRIOR TO SURFACING. NO MORE THAN 3 INLETS WILL BE PERMITTED PER 4 FT. (Y) LENGTH WITH A MIN. SPACING OF 1 FT. BETWEEN INLETS. THE TEMPORARY INLETS SHALL BE GROUTED SHUT AFTER COMPLETION OF SURFACING.
- ④ 3" TO 8" LUG PERMISSIBLE.



City of Coon Rapids
11155 Robinson Drive
Coon Rapids, MN 55433-3761
Tel: 763-755-2880
Fax: 763-767-6491
www.coonrapidsmn.gov

MnDOT STANDARD
PRECAST CURB OPENING CATCH BASIN

DRAWN: A.S.W.

DATE: 12/15/2014

SCALE:

PLATE NO. STM-5